


NOTE: SET 3" DISCHARGE PIPE TO SANITARY SEWER AT GRADE NECESSARY TO PROVIDE GRAVITY FLOW TO SANITARY SEWER AND FILL CONCRETE PIPE SUMP TO WITHIN 3" OF BOTTOM OF DISCHARGE PIPE AS SHOWN. USE AT LEAST 6" OF GRAVEL.

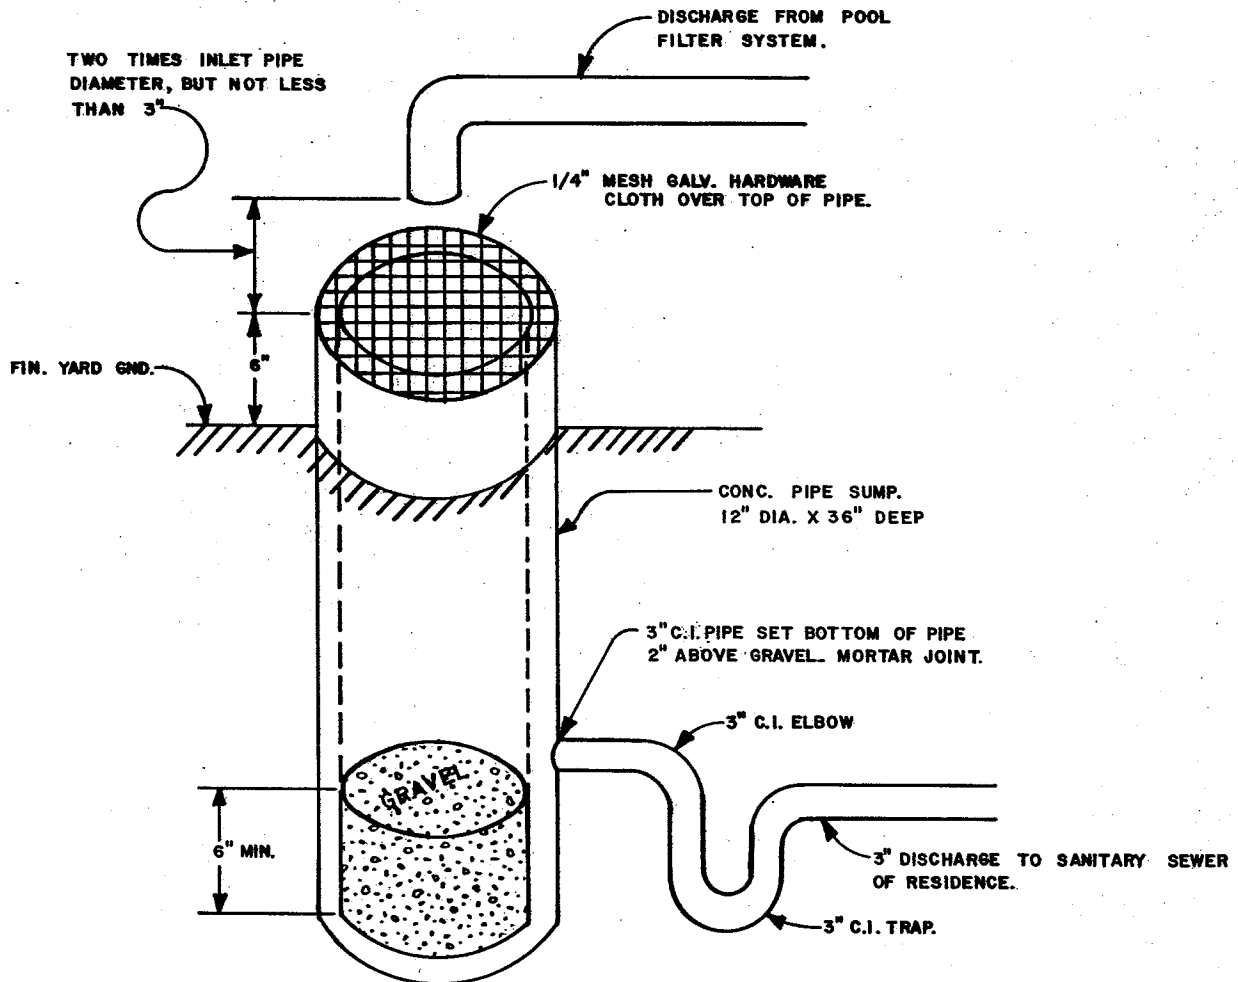

NOTE:
CITY WOULD PREFER USE OF FILTERS
NOT REQUIRING BACKWASH.

ENGINEERING DEPARTMENT

CITY OF MERCED, CALIF

SWIMMING POOL INDIRECT WASTE SYSTEM

DRAWN: R.D.

APPROVED BY:

DATE

ENG.

Steve M. Howard

1/21/80

REVISED

CITY ENGINEER

S-6

SHEET

OF