


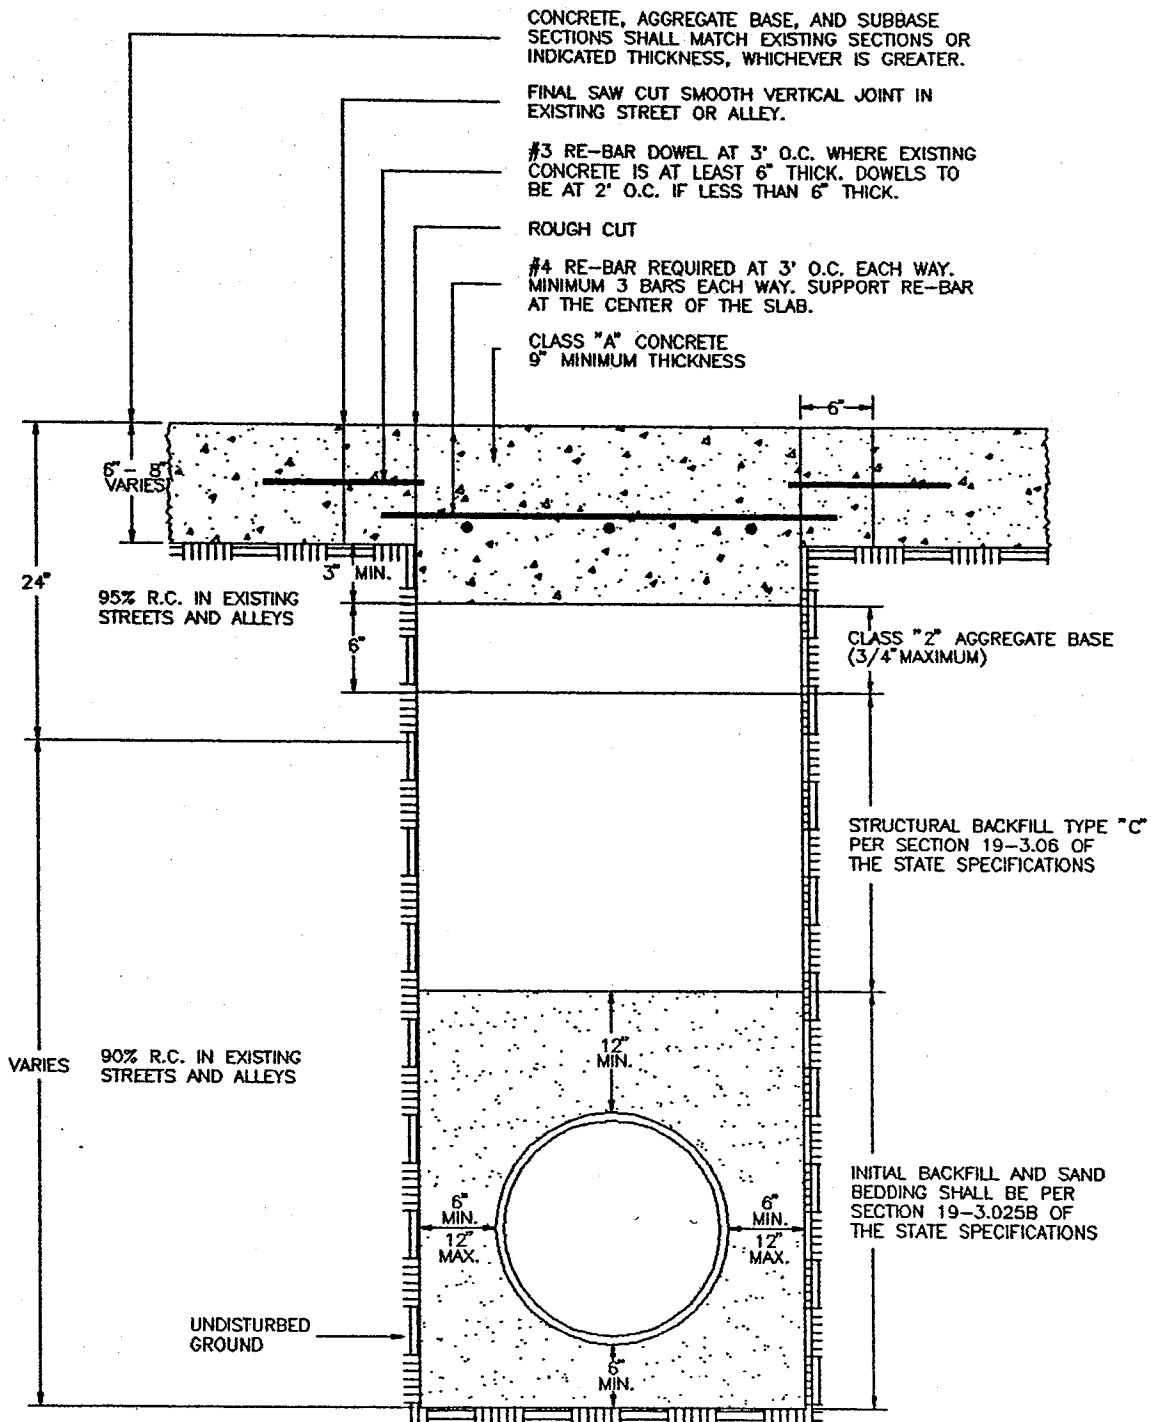

NOTES:

1. COMPACTION BY PONDING OR JETTING SHALL NOT BE ALLOWED.
2. MINIMUM REQUIREMENTS ARE SHOWN. SEE PROJECT SPECIFICATIONS FOR FURTHER REQUIREMENTS.
3. TRENCHES 5 FEET OR MORE IN DEPTH SHALL BE SHORED AS REQUIRED BY ARTICAL 6 DIVISION OF INDUSTRIAL SAFETY CONSTRUCTION SAFETY ORDERS (SEC. 6424 CALIF. LABOR CODE).
4. SEE CITY STANDARD T-2 FOR PORTLAND CEMENT CONCRETE PAVEMENT.
5. MAXIMUM LIFT THICKNESS FOR INITIAL AND STRUCTURAL BACKFILL SHALL BE .67 FEET BEFORE COMPACTION.

ENGINEERING DEPARTMENT

CITY OF MERCED, CA.

TRENCHING IN CONCRETE AREAS

DRAWN: MP

APPROVED BY:

DATE

ENG.

Steven M. Stroop

12-12-94

REVISED:

CITY ENGINEER

T-2

SHEET

OF