
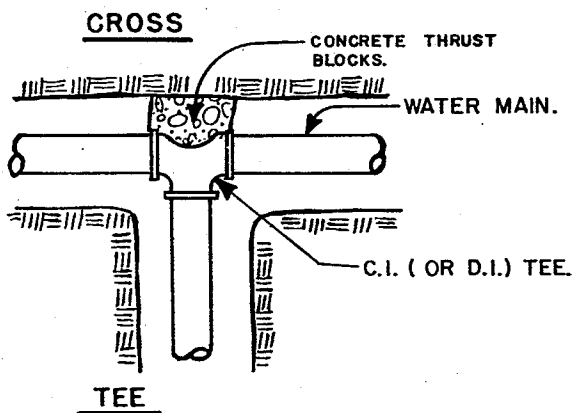
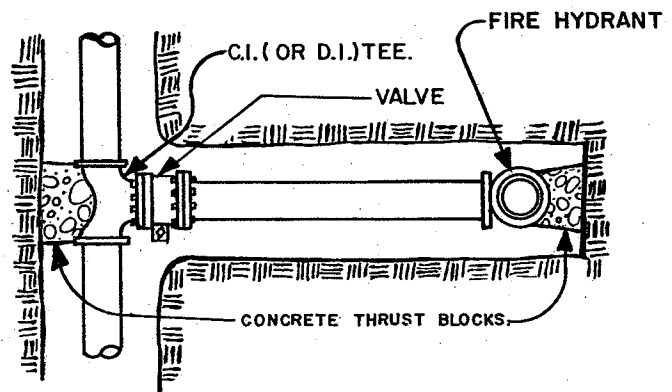
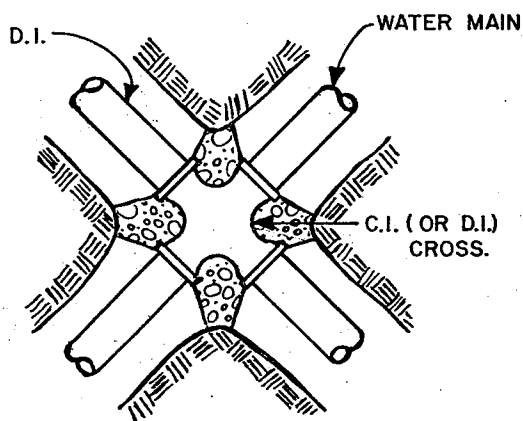
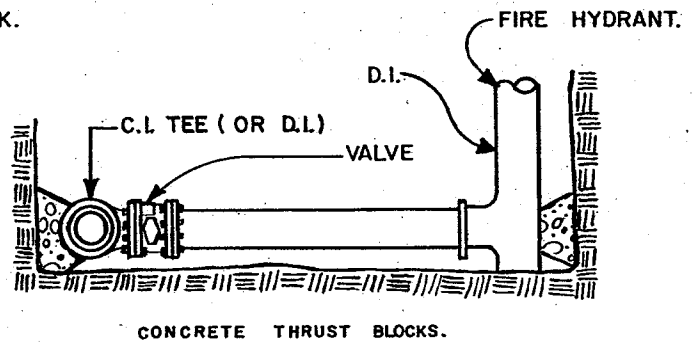


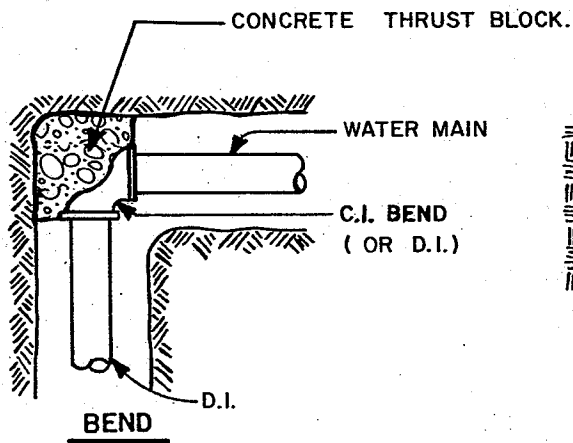

NOTE:

- (1) ALL CONCRETE FOR THRUST BLOCKS SHALL BE CLASS B.
- (2) C.I. DENOTES CAST IRON.
- (3) D.I. DENOTES DUCTILE IRON.
- (4) CONCRETE ANCHORS ARE TO BE KEPT CLEAR OF ALL PIPE AND VALVE JOINTS, NUTS, BOLTS, FOLLOWERS, GASKETS, ETC.

ENGINEERING DEPARTMENT

CITY OF MERCED, CALIF

CAST IRON FITTINGS WITH CONCRETE THRUST BLOCKS.

DRAWN: R.D.

APPROVED BY:

DATE

ENG. *S.L.G.*

Steven M. Stroud

5-25-79

REVISED

CITY ENGINEER

W - 6

SHEET OF