



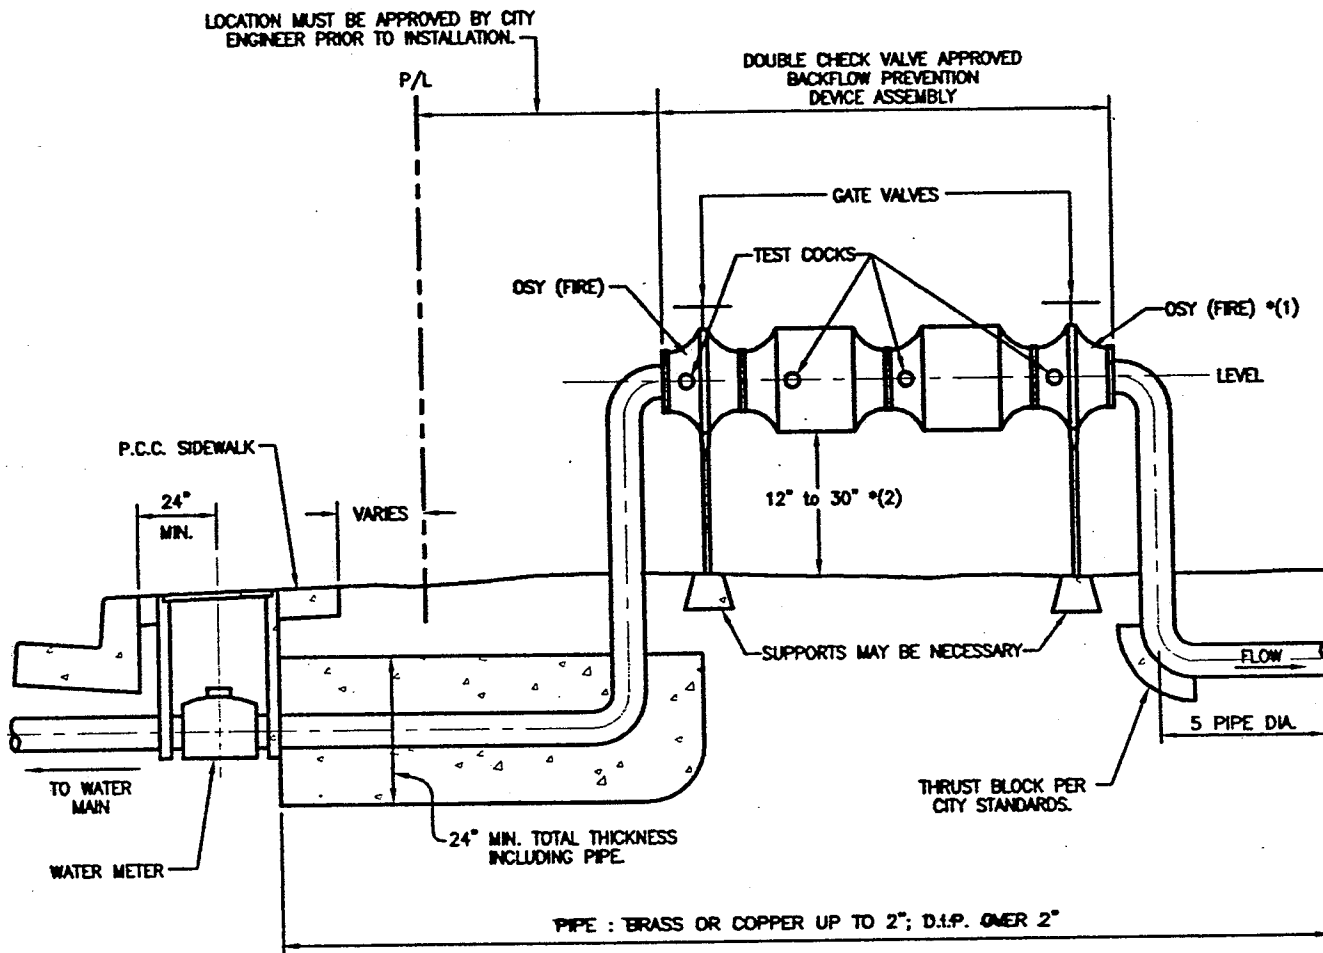

MINIMUM CLEARANCE			
SIZE / DC	A	B	C
1" - 3"	12"	18"	12"
4" & UP	24"	24"	12"

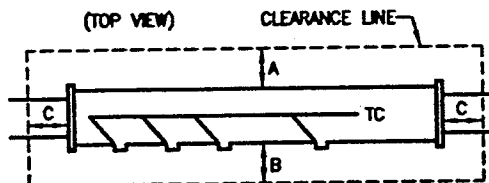

SEE CITY STANDARD W-17
FOR ADDITIONAL REQUIREMENTS

- * (1) - FIRE SPRINKLER SYSTEMS REQUIRE OSY VALVES; FOR DOMESTIC USE 3" AND LARGER, USE NRS VALVES.
- * (2) - MUST BE ABOVE 100-YEAR FLOOD ELEVATION ESTABLISHED BY FEMA.

ENGINEERING DEPARTMENT		CITY OF MERCED, CA	
DOUBLE CHECK VALVE BACKFLOW PREVENTER			W-8
DRAWN: KGE	APPROVED BY: <i>David L. Tucker</i>	DATE: 01/22/02	
DATE: 2/01	CITY ENGINEER		
REVISED:			
SHEET			OF