


NO. 500-9 5/16" STEEL PARKWAY
COVER. MIN 8" X 12" HINGED
METER READING DOOR REQUIRED
ON ALL COVERS.

BROOKS NO. W-500 UTILITY BOX OR
APPROVED EQUAL. SIZE OF THE BOX
SHALL BE SUBJECT TO THE APPROVAL
OF THE ENGINEER.

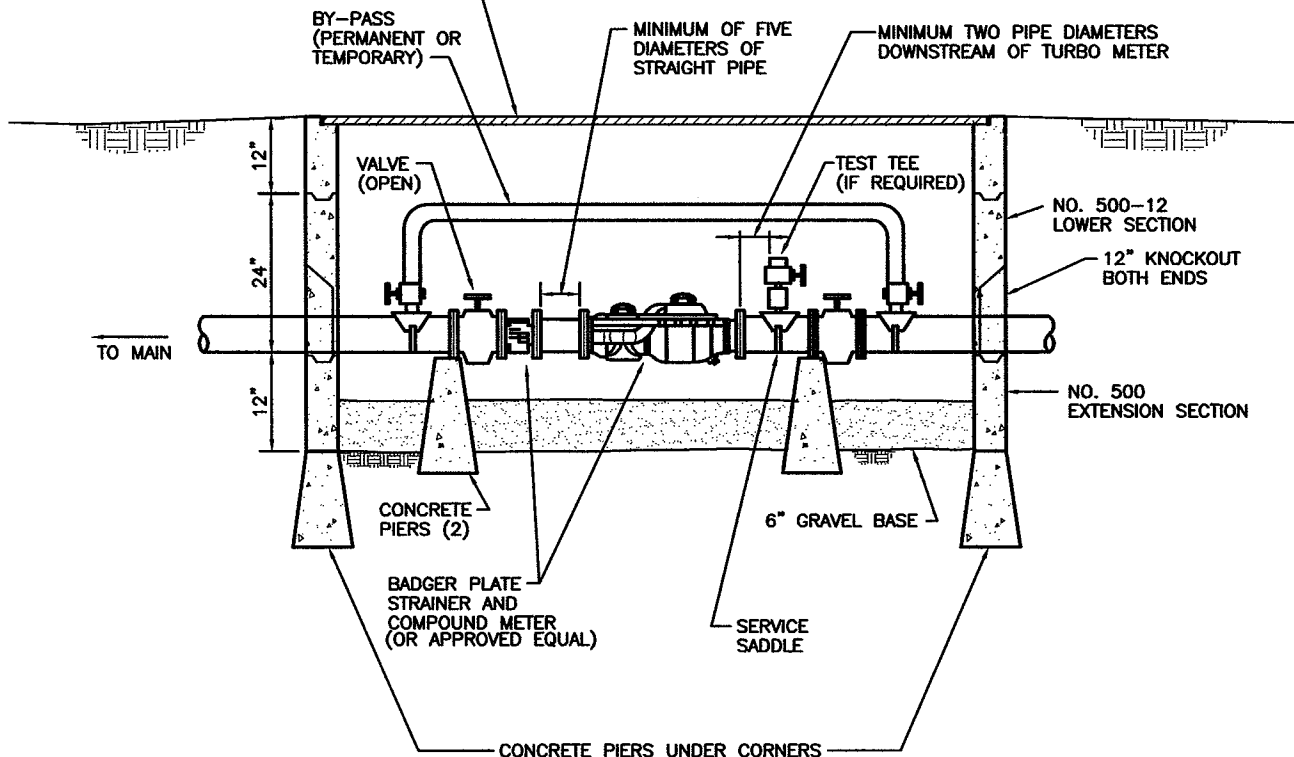

SECTION

NTS

NOTES

1. METERS FURNISHED BY CITY AT APPLICANT'S COST. METERS FURNISHED BY CONTRACTOR REQUIRE SUBMITTAL PRIOR TO ORDERING AND MUST BE ACCOMPANIED BY A CERTIFICATE OF COMPLIANCE WITH AWWA STANDARD C-702-78.
2. METER MAY BE MANIFOLDED TO ACHIEVE DESIRED MAXIMUM FLOW CAPABILITY AND FACILITATE MAINTENANCE.
3. METERS AND VALVES FOR SERVICES 3" AND LARGER SHALL BE ABOVE GROUND.

ENGINEERING DEPARTMENT

CITY OF MERCED, CA.

COMPOUND METER

W-14

DRAWN: KGE

APPROVED BY:

DATE

DATE: 5/82

David L. Tucker

3/17/08

REVISED: 3/17/08

CITY ENGINEER

SHEET

OF