


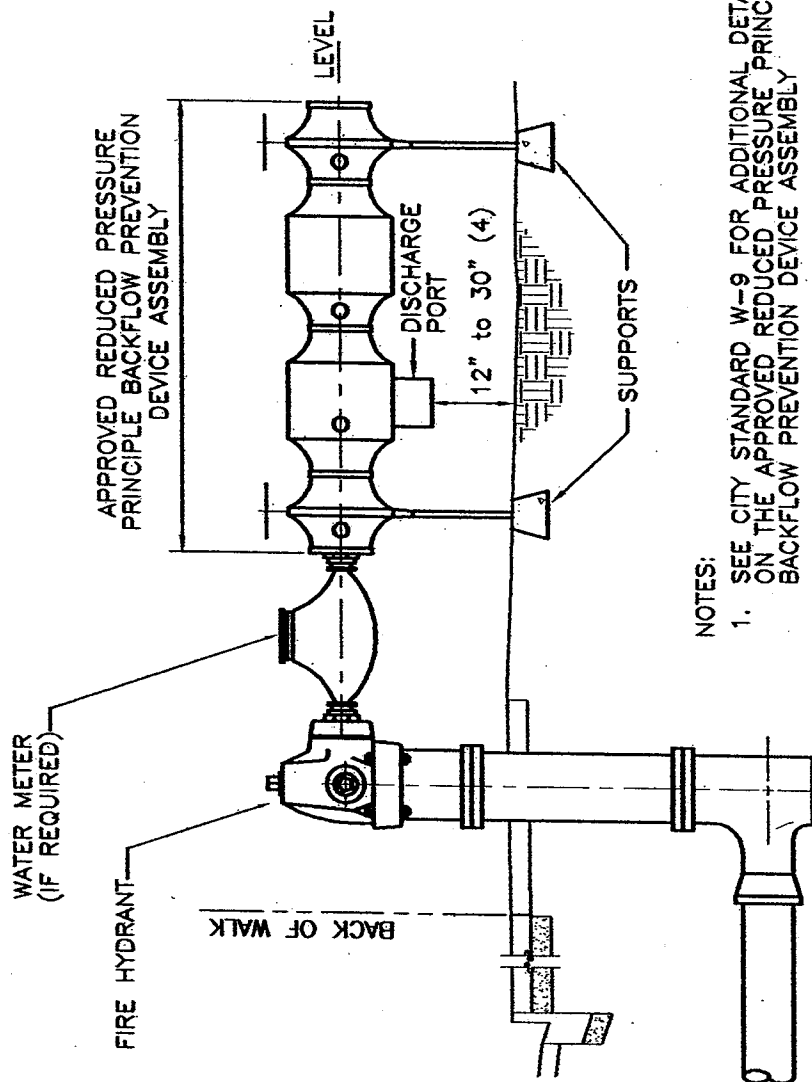

NOTES:

1. SEE CITY STANDARD W-9 FOR ADDITIONAL DETAILS ON THE APPROVED REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION DEVICE ASSEMBLY.
2. SEE CITY STANDARD W-2 FOR ADDITIONAL DETAILS ON THE FIRE HYDRANT AND VALVE ASSEMBLY.
3. THE BACKFLOW PREVENTION DEVICE ASSEMBLY SHALL BE PROVIDED BY THE CONTRACTOR. TESTING OF THE BACKFLOW ASSEMBLY DEVICE SHALL BE PERFORMED BY THE PUBLIC WORKS WATER DEPARTMENT AT TIME OF INSTALLATION.
4. MUST BE ABOVE 100-YEAR FLOOD LEVEL DESIGNATED BY FEMA
5. A CITY USE PERMIT IS REQUIRED.

NOT TO SCALE

ENGINEERING DEPARTMENT

CITY OF MERCED, CA.

WATER USE OUT OF A FIRE HYDRANT

W-35

DRAWN: KGE

APPROVED BY

DATE

DATE: 1/02

*David L. Tucker*

11/15/04

REVISED: 8/04

CITY ENGINEER

SHEET

OF